



PLAN VIEW

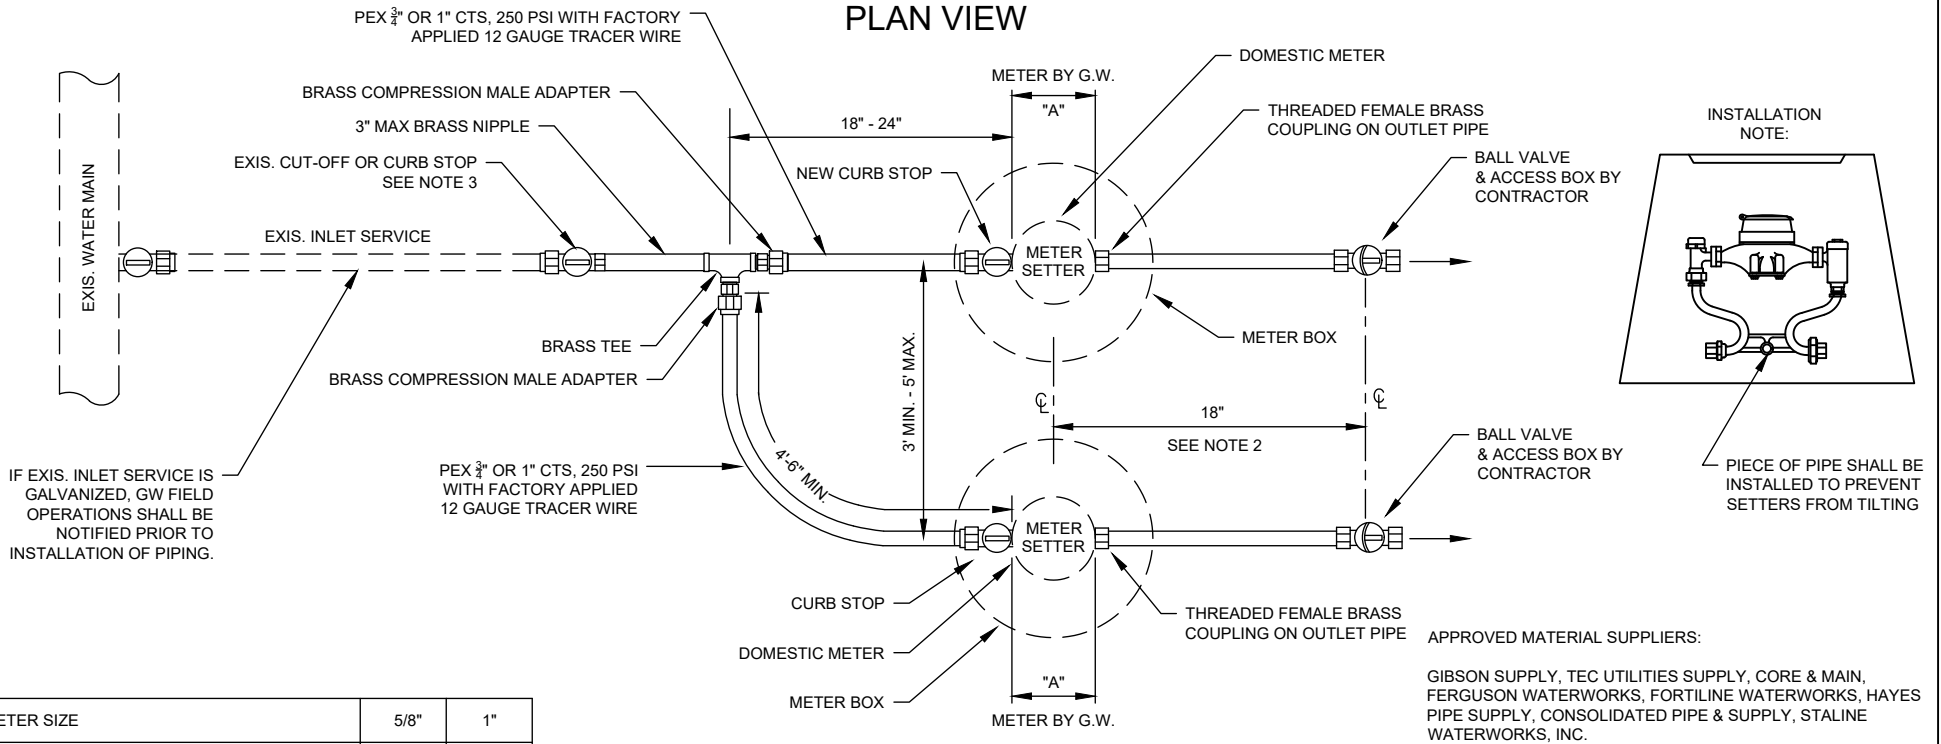

IF EXIS. INLET SERVICE IS GALVANIZED, GW FIELD OPERATIONS SHALL BE NOTIFIED PRIOR TO INSTALLATION OF PIPING.

INSTALLATION NOTE:

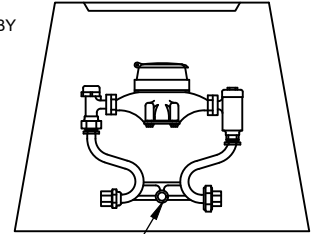

PIECE OF PIPE SHALL BE INSTALLED TO PREVENT SETTERS FROM TILTING

APPROVED MATERIAL SUPPLIERS:

GIBSON SUPPLY, TEC UTILITIES SUPPLY, CORE & MAIN, FERGUSON WATERWORKS, FORTILINE WATERWORKS, HAYES PIPE SUPPLY, CONSOLIDATED PIPE & SUPPLY, STALINE WATERWORKS, INC.

METER SIZE	5/8"	1"	
SPACE NEEDED BETWEEN FACE OF FEMALE COUPLING AND END OF PEX	"A"	11"	12 3/4"

GENERAL NOTES AND INSTALLATION BY CONTRACTOR:

- ALL WORK BY CONTRACTOR UNLESS SHOWN BY G.W.
- FOR METER INSTALLATIONS WHICH VARY FROM THAT SHOWN, CONTACT G.W. ENGINEERING PRIOR TO EXCAVATING.
- FOR EXISTING INLET SERVICES WITH NO CUT-OFF OR CURB STOP, IT IS THE CONTRACTOR'S RESPONSIBILITY TO EITHER CRIMP OR FREEZE THE EXISTING INLET SERVICE AND CUT IN A BRASS TEE. CONTRACTOR TO LEAVE OPEN FOR INSPECTION BY G.W. PRIOR TO BACKFILL.
- CONTRACTOR SHALL PROVIDE & INSTALL METER SETTERS MEETING G.W. SPECIFICATIONS. CONTACT G.W. ENGINEERING FOR LIST OF APPROVED METER SETTERS & BOXES.
- FINAL INSTALLATION SHALL BE SUCH THAT EACH METER CAN BE TURNED OFF INDIVIDUALLY.
- NEW INLET PIPING & FITTINGS MUST BE EXPOSED FOR INSPECTION WHEN METERS ARE SET.
- OUTLET PIPING CONSISTING OF THREADED FEMALE BRASS COUPLING, OUTLET SERVICE PIPE, AND BALL VALVE TO BE ASSEMBLED AND READY FOR INSTALLATION PRIOR TO G.W. ARRIVAL ON SITE.
- NEW INLET SERVICE PIPING TO BE PEX.
- METERS FOR COMMERCIAL IRRIGATION SERVICE REQUIRE SCDES APPROVED DCVA BACKFLOW PREVENTER BEHIND METER.

APPROVED MATERIALS			APPROVED MATERIALS		
TYPE	MANUFACTURER	PART NUMBER	TYPE	MANUFACTURER	PART NUMBER
AWWA x CTS CORP STOP (BALL STYLE, 300PSI)	A.Y. McDONALD	74701BG	COPPER METER SETTER	A.Y. McDONALD	720-209WDMM 33x995
	FORD	FB1000-3-G-NL			720-410WDMM 44x992
		MUELLER		FB1000-4-G-NL	VBHC72-9W-88-33-NL
CTS x FEMALE CURB STOP (BALL STYLE, 300PSI)	A.Y. McDONALD	76102G		MUELLER	B-2404N-6A
	FORD	B41-333-NL			B-2404N-2AN
		MUELLER		B25172N	A.Y. McDONALD
FEMALE FLARED x CTS ADAPTER	A.Y. McDONALD	74755G	FORD	CSS8-33-NL	
	FORD	C04-xx-G-NL		CS88-44-NL	
	MUELLER	H15071N	MUELLER	H14223N	
CTS x MALE ADAPTER	A.Y. McDONALD	74753G	METER BOX (18-INCH)	CARSON	2200-18 BLACK MSH 1
	FORD	C84-xx-G-NL	METER BOX LID (12 1/2-INCH)	CARSON	8-HOLE w/GREENVILLE WATER LOGO FOR 2200-18
	MUELLER	H15428N			



COMMERCIAL 5/8"x3/4" & 1" METERS - TAP TO SERVICE

REVISION DATE:	DETAIL NO:
01/27/2025	1.1
(NOT TO SCALE)	