



PLAN VIEW

EXCAVATION FOR TAPS

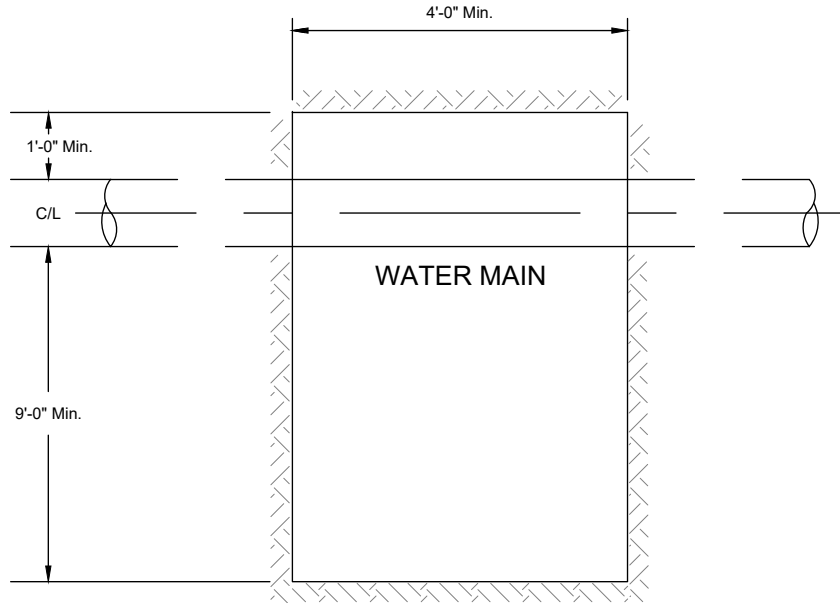

PLAN VIEW

EXCAVATION FOR TEES

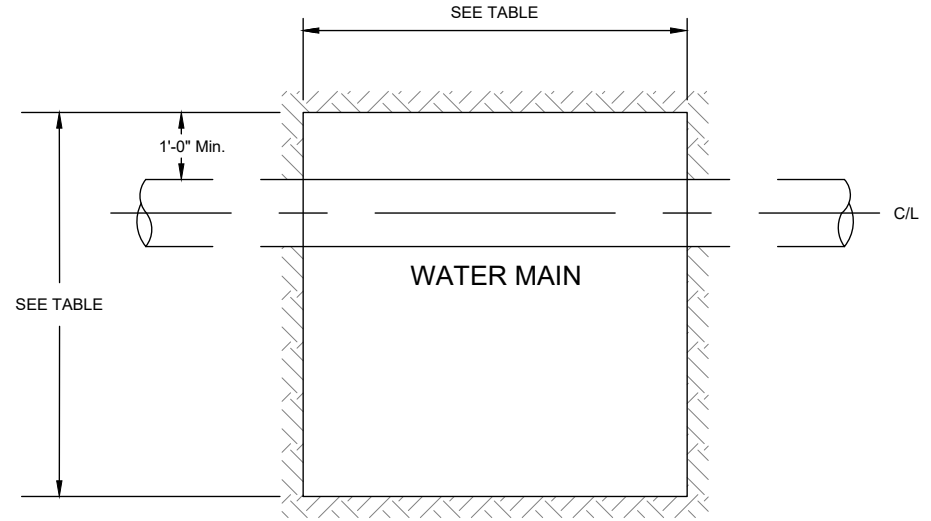

MIN. EXCAVATION REQUIRED FOR TEES	
TEE SIZE	MIN. EXCAVATION
8" AND SMALLER	6' x 6'
12" AND LARGER	8' x 8'

GENERAL NOTES :

1. ALL EXCAVATION TO BE DONE BY PLUMBER PRIOR TO G.W. ARRIVAL ON SITE.
2. HOLE TO BE WIDER & SHORED WHEN MAIN IS DEEPER THAN 5 FEET.
3. OSHA APPROVED TRENCH BOX OR SHORING AND LADDER TO BE PROVIDED BY CONTRACTOR IN EXCAVATION DEEPER THAN 5 FEET.
4. PLUMBER TO CONTACT G.W. ENGINEERING (864-241-6100) TO REPORT WHEN READY FOR CONNECTION TO BE MADE OR FOR ASSISTANCE IF UNUSUAL CONDITIONS EXIST.



GreenvilleWater

EXCAVATION REQUIRED FOR LARGE CONNECTIONS (2" AND LARGER)

REVISION DATE:

9.11.2024

(NOT TO SCALE)

DETAIL NO:

7