


**PLAN VIEW**

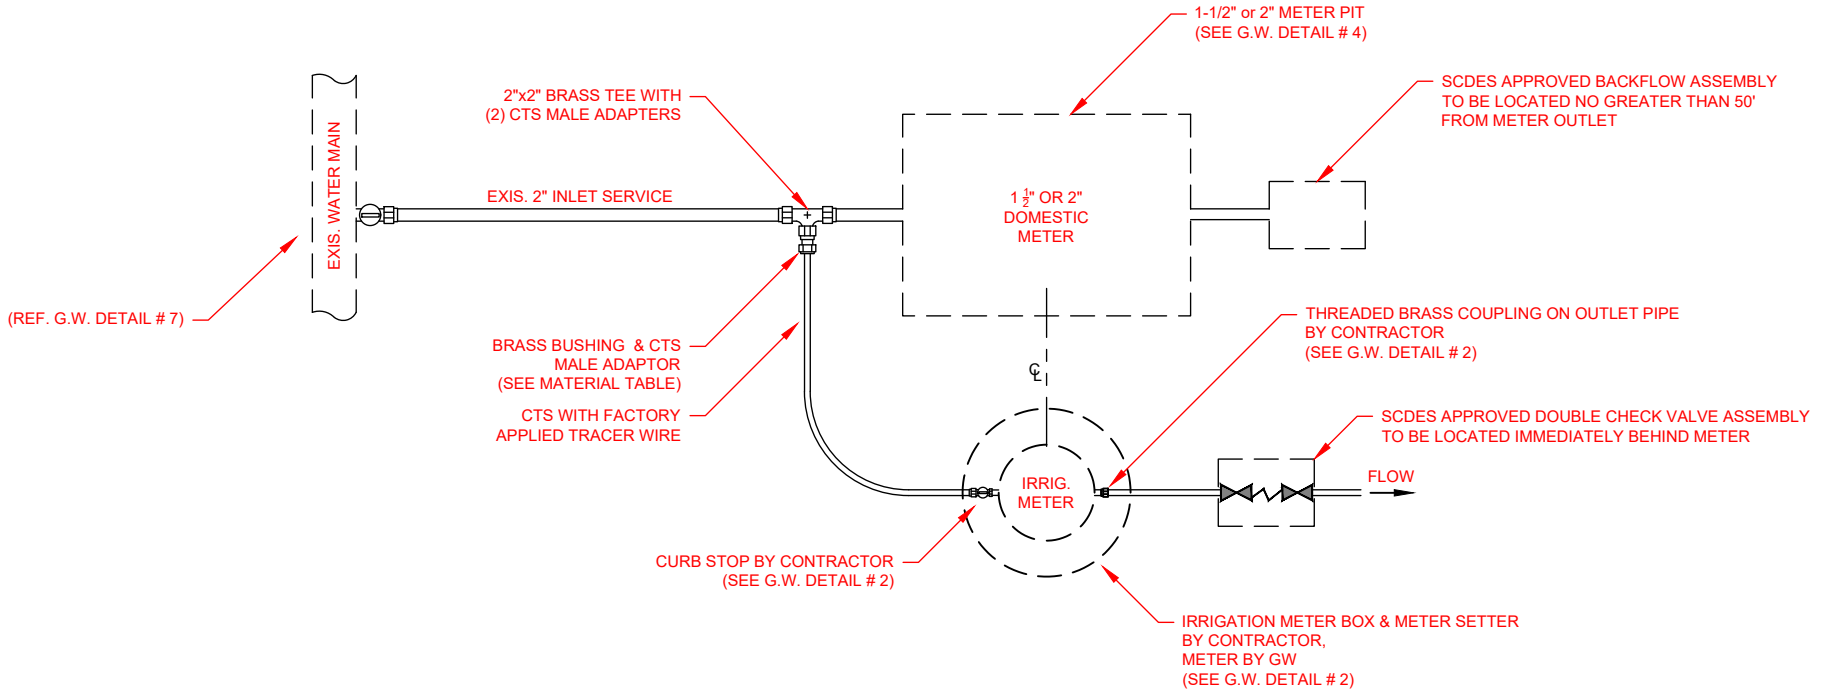

**GENERAL NOTES AND INSTALLATION BY CONTRACTOR:**

1. ALL WORK BY CONTRACTOR UNLESS SHOWN BY G.W.
2. CONTRACTOR TO USE PEX FOR INLET SERVICE.
3. FOR IRRIGATION METER INSTALLATIONS WHICH VARY FROM THAT SHOWN, CONTACT G.W. PRIOR TO EXCAVATING.
4. FOR EXISTING INLET SERVICES WITH NO CUT-OFF OR CURB STOP, IT IS THE CONTRACTOR'S RESPONSIBILITY TO EITHER CRIMP OR FREEZE THE EXISTING INLET SERVICE & CUT IN BRASS TEE. CONTRACTOR TO LEAVE OPEN FOR INSPECTION & BACKFILL AFTER INSPECTION.
5. THE CONTRACTOR SHALL PROVIDE & INSTALL METER SETTERS MEETING G.W. SPECIFICATIONS. (CONTACT G.W. ENGINEERING DEPT. FOR APPROVED LIST).
6. FINAL INSTALLATION MUST BE SUCH THAT EACH METER CAN BE TURNED OFF INDIVIDUALLY.
7. NEW INLET PIPING & FITTINGS MUST BE EXPOSED FOR INSPECTION WHEN METERS ARE SET.
8. OUTLET PIPING CONSISTING OF THREADED FEMALE BRASS COUPLING, 4' OF OUTLET SERVICE PIPE, AND BALL VALVE TO BE ASSEMBLED AND READY FOR INSTALLATION PRIOR TO G.W. ARRIVAL TO SITE.

FOR ALL METERS 1.5" AND LARGER, A SCDES APPROVED BACKFLOW PREVENTION ASSEMBLY SHALL BE INSTALLED NO GREATER THAN 50' FROM THE METER OUTLET. BACKFLOW PREVENTION ASSEMBLIES SHALL BE FIELD TESTED, AND A COPY OF THE FIELD TEST REPORT SHALL BE EMAILED TO BFP@GREENVILLEWATER.COM

THE BACKFLOW MUST BE INSTALLED IN THE UPRIGHT POSITION WITH THE MAKE AND MODEL LEGIBLE. THE TEST PORTS AND SHUT OFF VALVES MUST BE ACCESSIBLE. THE BACKFLOW DEVICE SHALL NOT BE INSTALLED MORE THAN 18" BELOW GRADE. DEVICE BOX SHALL BE FLUSH WITH GROUND LEVEL.

MATERIAL TABLE
3/4" INLET SERVICE
2"x3/4" BRASS BUSHING
1" INLET SERVICE
2"x1" BRASS BUSHING



**TAP TO SERVICE  
OFF  
2" INLET SERVICE LINE**

REVISION DATE:	DETAIL NO:
05.07.2025	4.1
(NOT TO SCALE)	